


no.	by	description	date
-	-	Issued For Permit & Construction	6/03/09
-	-	Issued For Client Review	3/24/09
revisions			

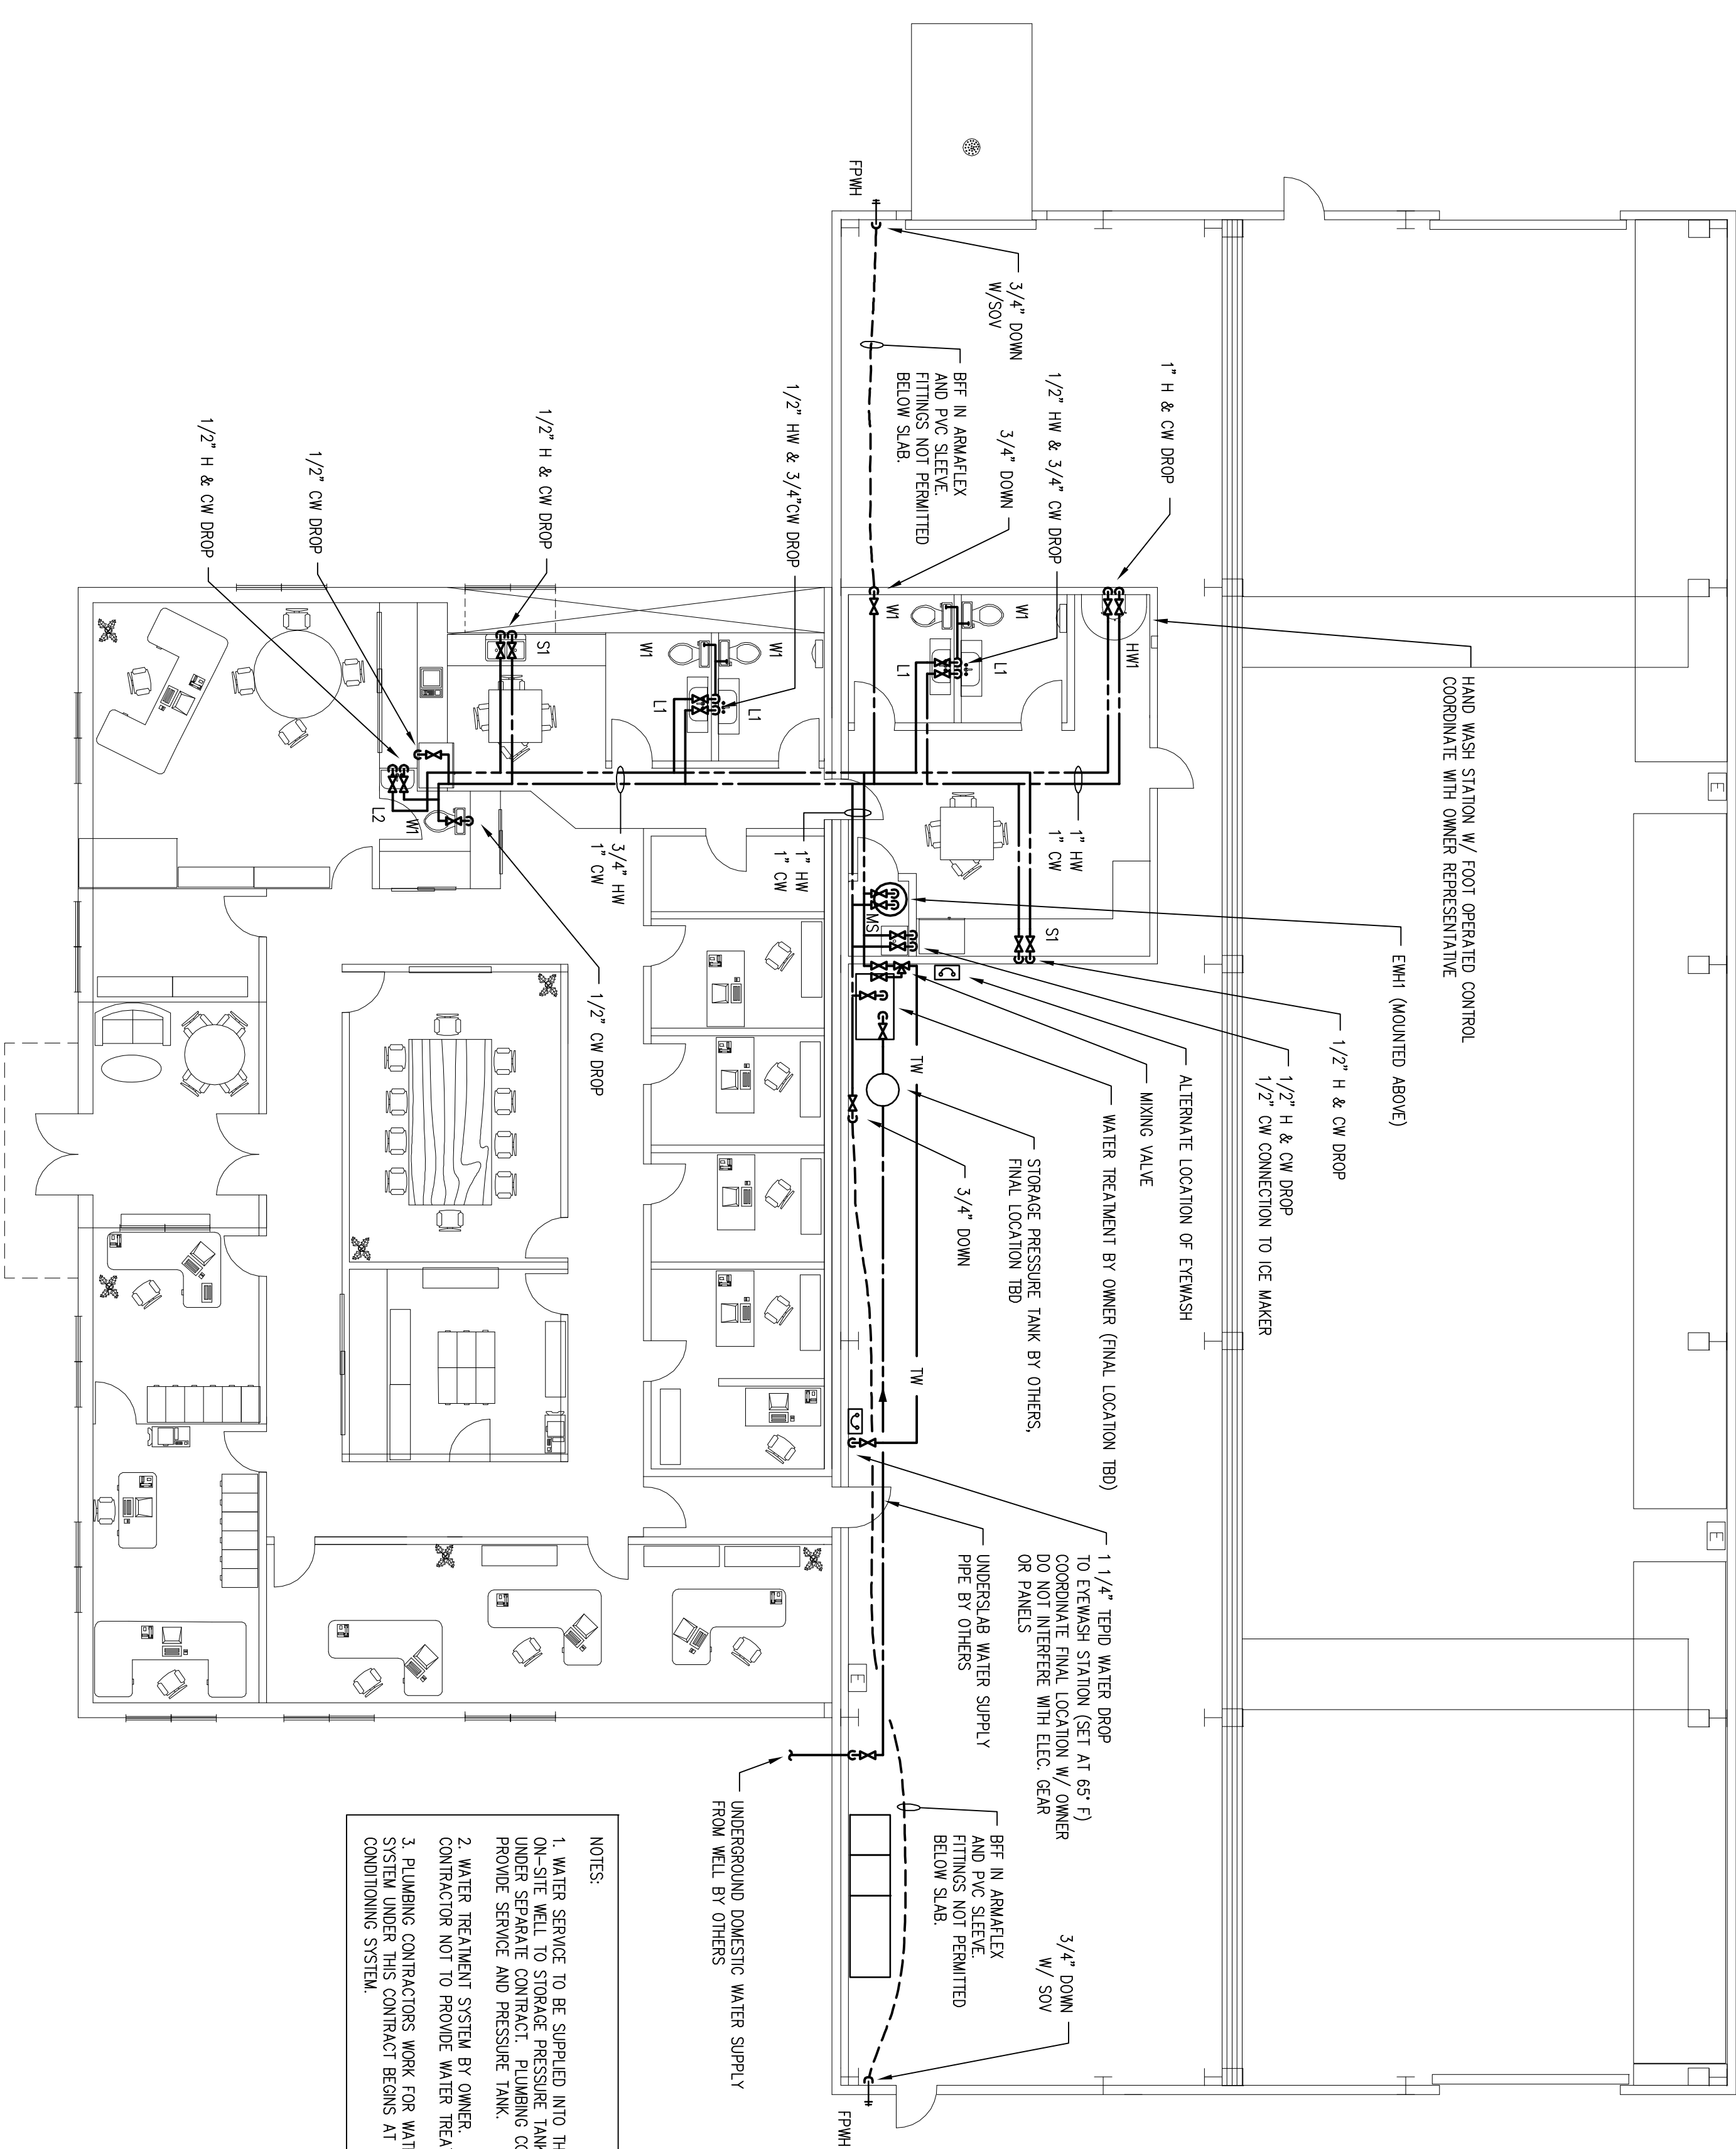


NOTES:  
 1. WATER SERVICE TO BE SUPPLIED INTO THE BUILDING FROM ON-SITE WELL TO STORAGE PRESSURE TANK BY OTHERS. PROVIDER SHALL BE RESPONSIBLE FOR PROVIDING CONTRACTOR NOT TO PROVIDE SERVICE AND PRESSURE TANK.  
 2. WATER TREATMENT SYSTEM BY OWNER. PLUMBING CONTRACTOR NOT TO PROVIDE WATER TREATMENT SYSTEM.  
 3. PLUMBING CONTRACTORS WORK FOR WATER DISTRIBUTION SYSTEM UNDER THIS CONTRACT BEGINS AT OUTLET OF WATER CONDITIONING SYSTEM.

**New Shop & Office Building for  
 Shupper-Brickle Equipment Co.  
 11 Burnt Tavern Road  
 Millstone Township, NJ 08535  
 Block: 57  
 Lot: 14.01**

BRIAN D. TANNENHAUS

NJ PROFESSIONAL ENGINEER  
 NO. GE 45901  
 DATE: June 3, 2009

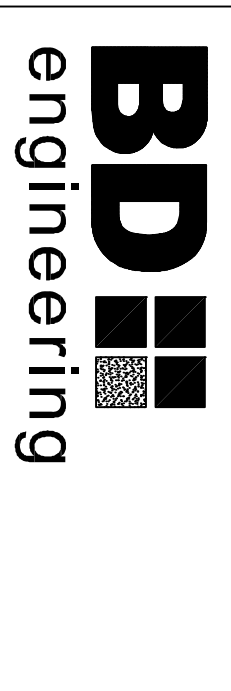

NJ CERTIFICATE OF AUTHORIZATION - 24042815100  
 BD Engineering, LLC 732-886-5432  
 1825 Swarthmore Ave. Lakewood, NJ 08701  
 Project No. 080056

DRAWN BY: BT  
 CHECKED BY: BT  
 SCALE: 1/8"=1'-0"

DOMESTIC WATER PLAN

DRAWING NO. P3.1